


URB 2
Home screen (steam boiler)

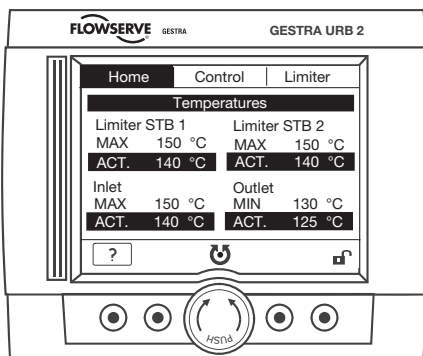

URB 2
Home screen (hot-water boiler)

Operating & Display Unit URB 2

System description

The URB 2 is an operating & display unit for all GESTRA CAN bus devices that uses the CANopen protocol to register all the data telegrams coming from the sensors, control units and actuators that are provided by the CAN bus.

The following readings, parameters and settings can be displayed and – with the exception of the actual values – also be changed by means of the URB 2.

Display – Start window	Level	Conductivity	Blowdown	Temperature
Actual value bar chart	●*			
Actual value, numerical	●	●*		●
Manual / Automatic operation	●	●		
Further indications				
MIN limit	●	●		●
MAX limit	●	●		●
Switchpoints, on / off	●	●		●
(De)-energizing times of relays	●	●		
Measuring range	●	●		
Setpoint, continuous	●	●		
Control parameter	●	●		
Valve position	●	●		
LW test	●			
Unit [µS/cm or ppm]		●		
Temperature compensation		●		
Stand-by		●		
Purging pulse 24h		●		
Intermittent blowdown interval			●	
Duration of intermittent blowdown			●	
Blowdown pulse			●	
Pulse intervall			●	

* 2nd water level indicator acc. to TRD 401, EN 12952/...53

** Temperature-compensated indication acc. to VdTÜV-Bulletin WÜ 100

Function

The operating & display unit URB 2 evaluates at regular intervals the data telegrams of all sensors, controllers and actuators in a CAN bus system. The readings, parameters, settings and messages are indicated in plain text. When used as second water level indicator in boiler plants (TRD 401, EN 12952 / ...53), the level is also indicated in the form of a bar graph.

Several languages can be selected for plain text display. The password protection prevents unauthorized persons from changing parameters and settings.

If you quit the start window, where parameters and settings are indicated and can be changed, the operating & display unit URB 2 returns to the start window after 5 minutes if no input is made.

The help function in the various operating levels offers additional information on how to operate the equipment.

The control knob with the integrated pushbutton allows the quick and easy navigation in all system levels as well as setting the parameters of the individual devices.

The equipment also features the following functions:

- Password protection
- Software updating (Flash)
- Reading the software versions of the CAN bus devices
- Display error messages

CAN bus

All controllers and associated equipment (for level, temperature and conductivity monitoring) are interconnected by means of a CAN bus using the CANopen protocol to DIN ISO 11898. Every item of equipment features an electronic address (node ID). The four-core bus cable serves as power supply and data highway for high-speed data exchange. The operating & display unit URB 2 is pre-configured at our works and ready for operation with other GESTRA devices.

Design

Case for panel mounting in control cabinets. The connectors are accessible at the rear of the unit. Cut-out dimensions: 174 x 145 mm.

Operating & Display Unit URB 2

Technical Data

Input / output

CAN bus interface with power supply 18-36 V DC, short circuit protected

Data exchange

CAN bus to ISO 11898, CANOpen protocol

Indicators and adjustors

- 1 Graphic display, resolution 320 x 240 pixels, illuminated
- 4 Pushbuttons
- 1 Control knob with integrated pushbutton (navigation wheel)

Wiring

2 Connecting plugs M 12, with 5 poles

Power consumption

5.2 VA

Protection

Front face: IP 54 to EN 60529

Rear panel: IP 10 to EN 60529

Admissible ambient temperature

0 – 55 °C

Case materials

Front face: Ultramid A3K

Casing: Enclosure: Sheet metal type DC01-A, surface yellow chromatinized

Weight

approx. 1.1 kg

ATEX (Atmosphère Explosible)

According to the European Directive 94/9/EC the equipment must **not** be used in explosion risk areas.

Important Notes

Note that screened multi-core twisted-pair control cable **is required** as BUS line, e.g. UNITRONIC® BUS CAN 2 x 2 x ... mm² or RE-2YCYV-fl 2 x 2 x ... mm² or the control cable assembly available as add-on equipment.

The cable length dictates the baud rate (data transfer rate) between the bus nodes, and the total power consumption of the sensor dictates the conductor size.

Cable length	Number of pairs and conductor size [mm ²]
125 m	2 x 2 x 0.34
250 m	2 x 2 x 0.5
335 m	2 x 2 x 0.75


For more information on cable lengths see installation instructions.

Order & Enquiry Specification


GESTRA Operating & display unit URB 2.

Supply in accordance with our general terms of business.

Dimensions

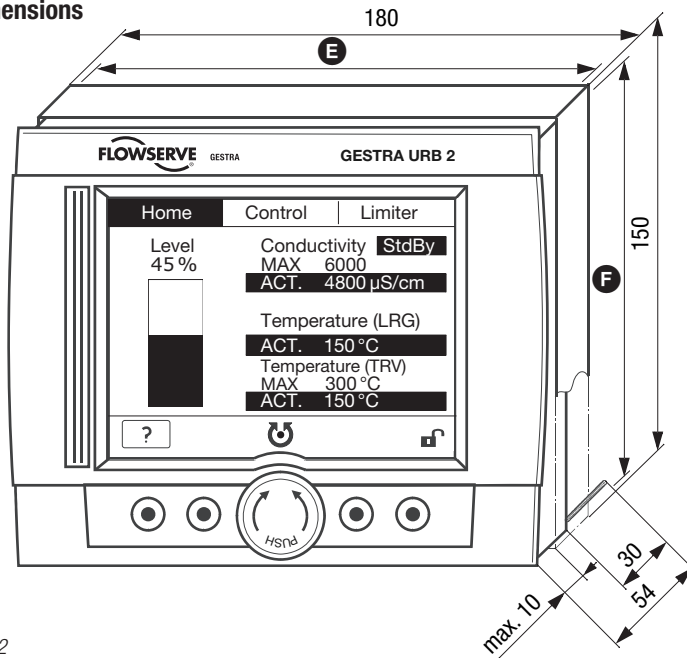


URB 2

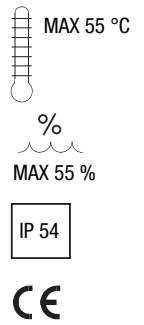


E	F
[mm]	[mm]
180	150

Wiring diagram

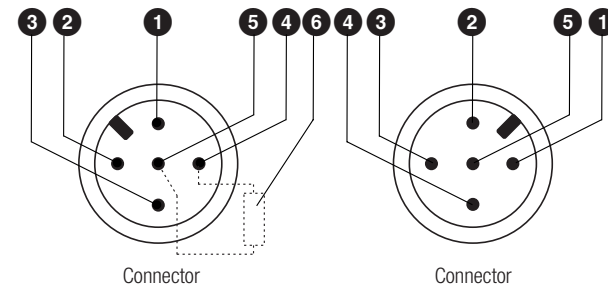

Key

- 1 Screen
- 2 Voltage supply 24 V DC+
- 3 Voltage supply 24 V DC-
- 4 CAN data line C_H
- 5 CAN data line C_L
- 6 Terminating resistor 120 Ω

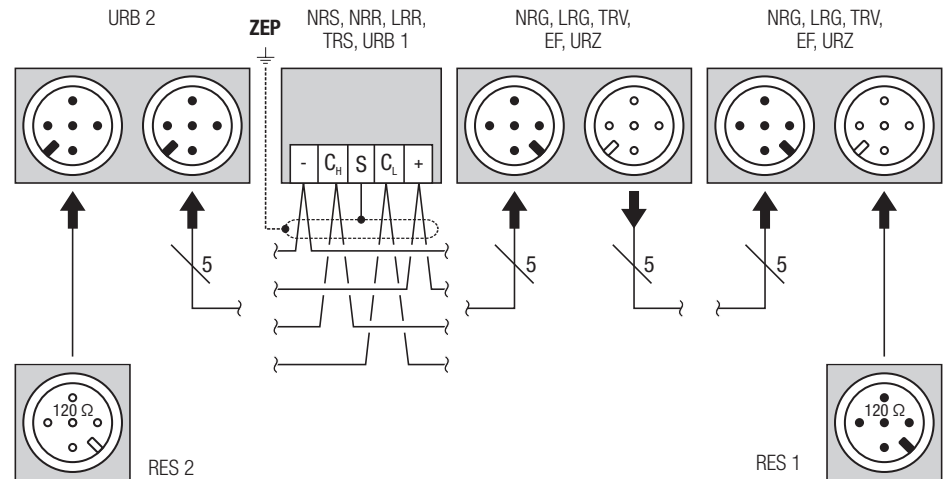

GESTRA AG

P. O. Box 10 54 60, D-28054 Bremen

Münchener Str. 77, D-28215 Bremen

Telephone 0049 (0) 421 35 03 - 0, Fax 0049 (0) 421 35 03-393

E-Mail gestra.ag@flowserve.com, Internet www.gestra.de



Distributor : Energy Technology Co., Ltd.

Tel.: +66 2 721 3860 - Fax.: +66 2 721 3869 - E-mail: sales@energytechnology.co.th - http:// www.energytechnology.co.th